


Architectural Grade

Job Name _____

Type _____

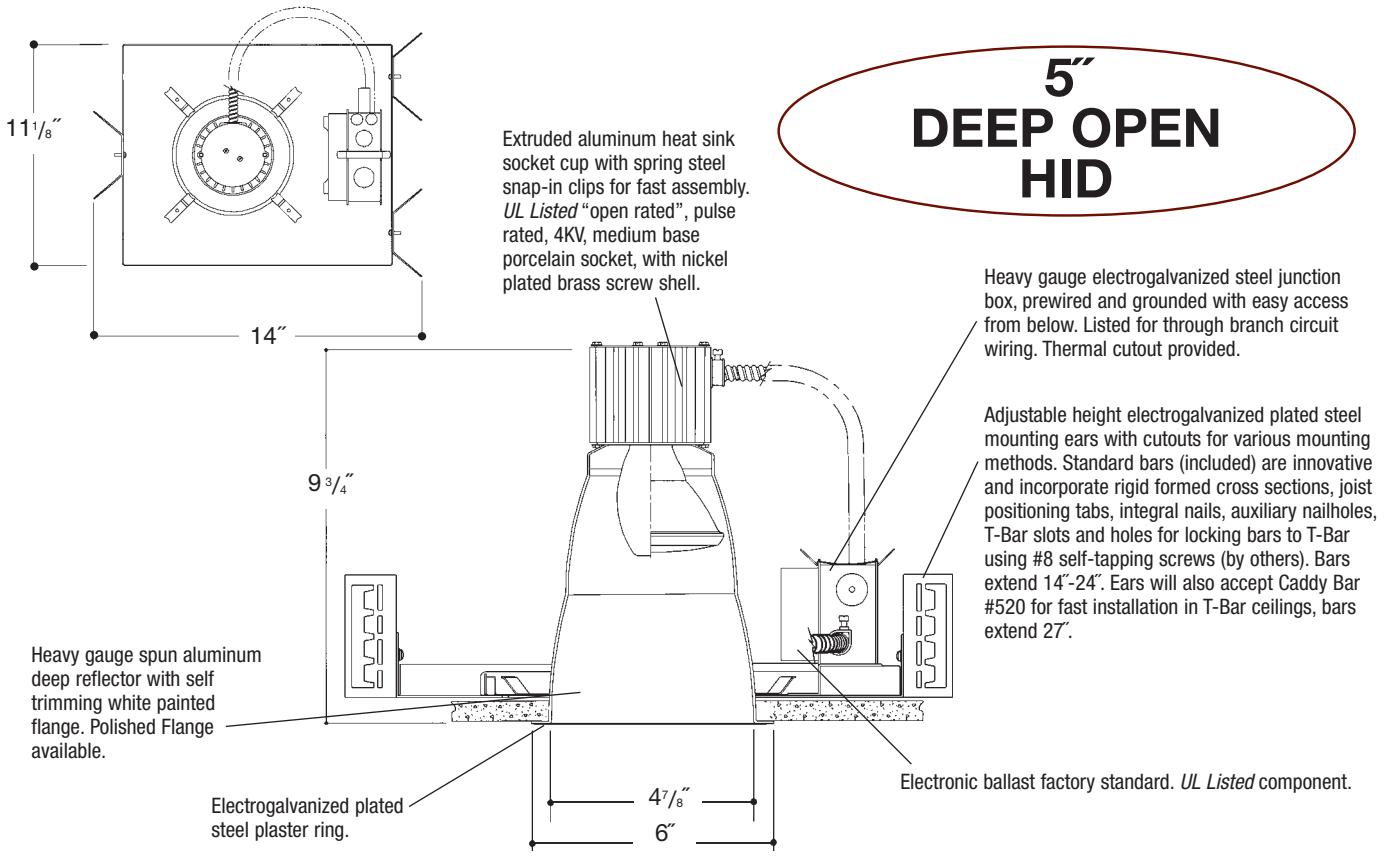

Rough In Kit – 5" HID (ED17; PAR20; PAR30 Open Rated* Lamps) *Note: 'Open Fixture Rated' lamp must be used.

Catalog Number **A5MHO**

A5MHO	Wattage	Ballast	Voltage	Options	Ballast	Electronic
	70W MAX. PAR30, ED17	E	1		E	Electronic
	50W ED17		2		1	120 Volts
	39W PAR20, PAR30		4		2	277 Volts
	35W ED17				4	208 Volts
					Options ▲	

PAR Lamp – Add P – PA5MHO

Finishing Kit – 5" HID Deep Open Reflector

Catalog Number **5500**

5500	Finish	Options	Finish (Factory Standard)
	SCL	PF	SCL Specular Clear "Alzak" Reflector with White Flange
	SGO	GSK	SGO Specular Gold "Alzak" Reflector with White Flange
	WHT		WHT White Reflector with White Flange
			Options ▲
			PF High Polished Flange
			GSK Neoprene Foam Single Gasketing

Features

Manufactured and Listed to UL 1598, ETL and CSA standards. Suitable for Damp Locations Wet location under covered ceiling



▲ See Options and Finishes pages for a list of additional finishes and equipment.

Vantage reserves the right to change components, finishes or design details in any manner which does not alter the installed appearance or reduce performance and intended function.

76 Community Avenue Plainfield, CT 06374
 voice (860)564.4512 fax (860)564.4854
 www.vantageltg.com

03/10

